



Robust tuning of a generalized predictor-based controller for integrating and unstable systems with long time-delay

Pedro García, Pedro Albertos*

Department of Systems Engineering and Control, Instituto de Automática e Informática Industrial, Universitat Politècnica de València, Valencia, Spain



ARTICLE INFO

Article history:

Received 17 January 2013

Received in revised form 19 June 2013

Accepted 17 July 2013

Keywords:

Long time delay

Dead-time compensation

Integrating and unstable systems

Robustness

Smith predictor

ABSTRACT

In this work, a general structure to control long time-delay plants is proposed and an easy methodology to tune the control parameters is outlined. All the sensitivity transfer functions are delay free. The proposed scheme is equivalent to the Smith predictor but able to cope with any kind of systems, including non-minimum phase, unstable and integrating plants. The controllers are designed based on the delay free model. Contrary to other approaches, other than for the digital implementation, no delay approximation is used. A tuning parameter is provided in order to reach an intuitive tradeoff between performance and robust stability. A comparative analysis with respect to recently successful proposals shows a substantial improvement in the performance/robustness tradeoff as well as in the tuning process.

© 2013 Elsevier Ltd. All rights reserved.

1. Introduction

Most industrial processes are characterized by the presence of time delays [23]. Conventional controllers, such as PID controllers [6], could be used when the dead-time is small but they show poor performance when the process exhibits long dead-times [12]. In these cases, it is convenient to introduce a dead-time compensating (DTC) structure [22].

DTCs structures include a model of the process in order to cope with the dead time. The Smith predictor (SP) [30] was the first and seminal proposal. As it is well known, the main idea is to generate the undelayed plant response by using the available information: the process input and output and the process model. The main advantage of the SP method is that time delay is eliminated from the characteristic equation (not only from the set-point to output transfer function but from all the sensitivity functions of the closed-loop system). Thus, the analysis and design problem for processes with delay can be translated into a delay-free one. On the other hand, as the SP uses the actual model of the plant, it presents several problems in presence of integrating or unstable processes [11,22], being also sensitive to time delay uncertainty [20].

The control community has devoted a great effort against such drawbacks. Some DTCs have been proposed to simplify and improve the tuning of the controller [12–14,21,32], to reject load disturbances for processes with integration and long

dead-time [5,9,18,25,33,35], and to control unstable time-delay systems [1,8,15–17,24,31,34]. However, for integrating and unstable systems none of the proposed schemas, except those proposed in [1,24], fulfill the SP principle, the time delay being eliminated from all the sensitivity function of the closed loop system [10].

Several PID-based design methods have been proposed for the control of integrating and unstable processes with time delay. The tuning design can be performed following different approaches (see [27] for a tutorial on the topic) but there is always an approximation in the delay term to obtain the final PID control structure [31]. Some times this PID algorithm is in cascade with a lead-lag first or second order filter [27]. A common drawback in this kind of approaches is that ideal PID controllers are usually proposed, but the tuning of the PID derivative filter is not a simple issue. Small values of the time constant of this filter causes strong control action and poor noise attenuation. On the other hand, large values may drive the system to instability [6,10].

Recently the so called MSP-PID controller has been proposed in [19] to cope with stable, integrating and unstable processes. The proposal can be implemented as a DTC control structure or in a PID form in a two-degree of freedom control structure although a better set-point tracking is obtained in the later implementation form. In this MSP-PID controller, the control parameters of the main controller are obtained by solving an optimization problem, and a second order Padé approximation is used to get an effective realization of the DTC control structure.

In this work, a general structure to control stable, integrating or unstable long delayed plants based on a generalized predictor (GP), [1], is presented and a methodology for an easy and robust

* Corresponding author: Tel.: +34 963879570; fax: +34 963879579.

E-mail addresses: pedro@iai.upv.es, pggil@isa.upv.es (P. Albertos).

tuning of the control parameters is proposed. The control structure includes four blocks: the main controller, an optional set-point filter, the undelayed output predictor and a prediction error filter. A new parameter is introduced in both, the predictor and the prediction error filter to get a tradeoff between performance and robust stability, keeping in mind that the waterbed effect between the sensitivity and complementary sensitivity function is unavoidable [29]. The principal advantages of the proposed structure is the easy tuning and industrial implementation as well as the intuitive effect of the control parameters. The tuning procedure is shown to be simple and easy to apply to a variety of processes, including those with a long dead-time. It is worth to note that, except for the predictor, the remaining blocks are independent of the delay, although the final behavior is unavoidably affected by the delay. A re-tuning of the control structure parameters may reduce this effect.

This paper is organized as follows. First, the ideal, undelayed control situation is reminded. Then, the structure and components of the GP are summarized. The proposed predictor-based control is described and a simple procedure to tune the different parameters in the control structure is outlined. In particular, the use of the new parameter (λ) to improve the controlled plant robustness is discussed. Some examples, applying this approach to some typical plants already used in the literature, illustrate the design methodology and the achieved improvements with respect to recently presented alternative approaches. Some comments and suggestions are drafted in the last section.

2. Problem statement

An input-output delayed SISO process can be described by

$$P_p(s) = G_p(s)e^{-L_p s} \quad (1)$$

where L_p is the time-delay and $G_p(s)$ represents the undelayed dynamics. Due to modeling errors and uncertainties, the plant model

$$P(s) = G(s)e^{-L_s} \quad (2)$$

differs from the actual plant. Since in any practical application a computer is used to implement the control law [7], it is justified to study the overall closed-loop system in the discrete framework.

Thus, the discrete time (DT) behavior of the actual plant will be represented by the DT transfer function

$$P_p(z) = G_p(z)z^{-d_p} \quad (3)$$

where the time delay will be approximated by a multiple of the sampling period¹, T , being $L_p = d_p T$, $d_p \in \mathbb{N}$. The assumed plant model is

$$P(z) = G(z)z^{-d} \quad (4)$$

For perfect model matching, $P(z) = G(z)z^{-d} = P_p(z)$, with $L = L_p = dT$.

The ideal setting to design the control is to keep the delay out of the loop and design the control structure for the undelayed plant. Assume a plant as depicted in Fig. 1, where the undelayed output $\bar{y}(z)$ is accessible. The ideal system output is

$$y(z) = K_f(z) \frac{K(z)G(z)z^{-d}}{1 + K(z)G(z)} r(z) \quad (5)$$

$$+ \frac{G(z)z^{-d}}{1 + K(z)G(z)} w(z) \quad (6)$$

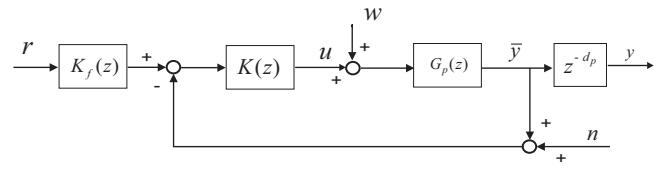


Fig. 1. Ideal delay-free loop.

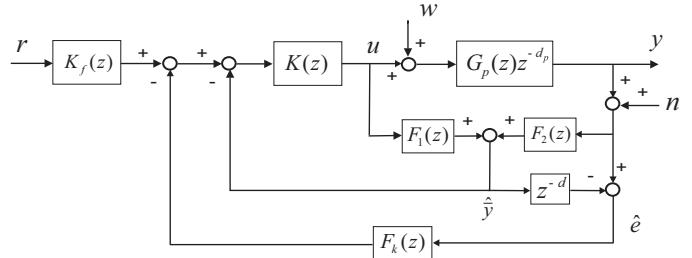


Fig. 2. Predictor-based control structure.

$$- \frac{K(z)G(z)z^{-d}}{1 + K(z)G(z)} n(z) \quad (7)$$

The controller $K(z)$ may be designed to achieve some desired performance on the closed-loop disturbance response, whereas the filter $K_f(z)$ can be designed to fulfil the tracking performance. If $K(z)$ is properly designed, the system is proved to be internally stable [4].

In general, the undelayed plant output, \bar{y} , is not accessible and a model-based predictor should be implemented. The predictor should work for any kind of systems.

3. Generalized predictor structure

In order to design a delay free control, an undelayed output $\bar{y}(z)$ should be predicted based on the current available information: $u(z)$, $y(z)$ and the plant model. The proposed predictor structure is shown in Fig. 2.

In this way, the predicted undelayed output will be

$$\hat{y}(z) = F_1(z)u(z) + F_2(z)[y(z) + n(z)] \quad (8)$$

In the GP, as initially presented at [1], two stable filters based on the plant model are computed. In this work, in order to improve the robust tuning of the overall closed-loop system, a new but equivalent undelayed output predictor $\bar{y}(z)$ is considered. This predictor includes a design parameter, λ , that can be tuned in order to get an easy and intuitive tradeoff between load disturbance rejection and robust stability.

3.1. Undelayed output predictor

Let us consider an equivalent model of the plant (4) represented by

$$P(z) = G(z)z^{-d} = \frac{N(z)}{D(z)}z^{-d} = \tilde{G}(z, \lambda)\Gamma(z, \lambda)z^{-d} \quad (9)$$

where the plant zeros are collected in

$$\Gamma(z, \lambda) := \frac{N(z)}{(z - \lambda)^m}; |\lambda| < 1 \quad (10)$$

where λ is the tuning parameter and m is the number of zeros on the polynomial $N(z)$.

¹ As the control structure should be robust under model parameters uncertainty, the round-off of the fractional delay will not be a problem.

Remark 1. If $\lambda=0$ and only the non-minimum phase zeros are collected in $N(z)$, the process model decomposition considered in [1] is obtained.

According to (9) and (10), the transfer function $\tilde{G}(z)$ including all the system's poles is

$$\tilde{G}(z, \lambda) = \frac{(z - \lambda)^m}{D(z)} = \frac{\tilde{N}(z, \lambda)}{D(z)} = c(zI - A)^{-1}b \quad (11)$$

where (A, b, c) ² is a minimum order state space model, very convenient to make easier the following computations.

Let us define also a new transfer function

$$\tilde{G}^*(z, \lambda) := c(zI - A)^{-1}A^d b = \frac{\tilde{N}^*(z, \lambda)}{D(z)} \quad (12)$$

Lemma 3.1. For any process, no matter being stable/unstable and minimum/non-minimum phase, denoting by (A, b, c) a minimum order state space representation of $\tilde{G}(z, \lambda)$, including the possibly unstable part of the transfer function, the stable filters in (8) computed by

$$F_1(z, \lambda) = \Phi(z, \lambda)\Gamma(z, \lambda) \quad (13)$$

$$F_2(z, \lambda) = \frac{\tilde{N}^*(z, \lambda)}{(z - \lambda)^m} \quad (14)$$

where

$$\Phi(z, \lambda) := c(\lambda) \sum_{i=1}^d A^{i-1} b z^{-i} \quad (15)$$

provide a stable undelayed output estimation.

Proof. The proof follows a reasoning similar to that in Lemma 3.1 of [1] (see Remark 1). For the nominal undisturbed plant (9), assuming $w = 0$ and $n = 0$, the undelayed output is obtained by:

$$\hat{y}(z) = \tilde{G}(z, \lambda)\Gamma(z, \lambda)u(z) \quad (16)$$

Taking into account (11) and (12), that is³

$$\tilde{G}^* = \frac{\tilde{N}^*}{(z - \lambda)^m} \tilde{G} \quad (17)$$

adding and subtracting \tilde{G}^*z^{-d} from (17) in (16), it can be rewritten as

$$\hat{y} = [\tilde{G} - \tilde{G}^*z^{-d} + \frac{\tilde{N}^*}{(z - \lambda)^m} \tilde{G}z^{-d}] \Gamma u$$

But from (14) and (9), it results

$$F_2 y = \frac{\tilde{N}^*}{(z - \lambda)^m} \tilde{G}\Gamma(z, \lambda)u$$

$$\hat{y} = [\tilde{G} - \tilde{G}^*z^{-d}] \Gamma u + F_2 y(z)$$

On the other hand, it is easy to verify that:

$$(zI - A) \sum_{i=1}^d A^{i-1} z^{-i} = I - A^d z^{-d} \quad (18)$$

$$\sum_{i=1}^d A^{i-1} z^{-i} = (zI - A)^{-1} [I - A^d z^d]$$

² If a controllability canonical representation is chosen, the λ -parameter only appears in the vector $c(\lambda) \in \mathbb{R}^{1 \times n}$. This is assumed in the following, to simplify the notation.

³ In the following, the arguments z and λ , if not needed, are avoided to simplify the notation.

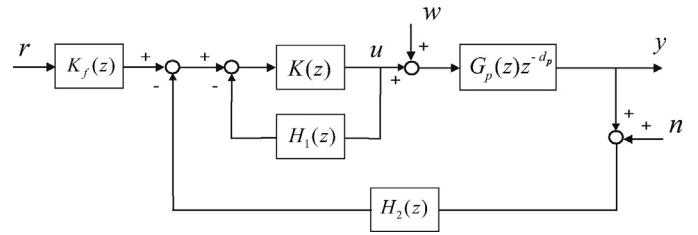


Fig. 3. Simplified control structure for analysis proposes.

Thus, premultiplying (18) by c and postmultiplying by $b\Gamma$, it yields F_1 in the left hand side and the right hand side, taking into account (11) and (12), leads to (13):

$$F_1 u = (\tilde{G} - \tilde{G}^*z^{-d})\Gamma u$$

proving the lemma. \square

■

3.2. Prediction error compensation

Due to disturbances and model uncertainties, there is an error in the prediction, such that

$$\hat{e} = y - \hat{y}z^{-d}$$

This predictor error can be used to improve the behavior of the controlled plant if the control is generated through the predicted undelayed output, as described in the next section.

4. Control structure

The predictor-based control structure is shown in Fig. 2, where there is a main controller $K(z)$ and the optional set-point filter $K_f(z)$. In order to improve the robustness, a predictor error filter $F_k(z)$ can be added, being tuned to achieve a tradeoff between performance and robust stability. This filter can be any stable and unitary steady-state gain filter (see [1,9]).

Lemma 4.1. In the nominal case, from the schema in Fig. 2, and according to Lemma 3.1, the following expressions are obtained:

$$y = K_f \frac{KGz^{-d}}{1 + KG} r \quad (19)$$

$$+ \frac{Gz^{-d}}{1 + KG} w - \frac{KGz^{-d}}{1 + KG} H_1 w \quad (20)$$

$$- \frac{KGz^{-d}}{1 + KG} H_2 n \quad (21)$$

where

$$H_1 := (F_1 - F_k F_1 z^{-d}) \quad (22)$$

$$H_2 := (F_2 + F_k - F_k F_2 z^{-d}) \quad (23)$$

Proof. The control structure depicted in Fig. 2 can be simplified as shown in Fig. 3, where H_1 and H_2 are expressed by (22) and (23).

Thence, the following expressions are obtained:

$$\begin{aligned} y &= K_f \frac{KP_p}{1 + K(H_1 + H_2 P_p)} r \\ &+ \frac{P_p}{1 + K(H_1 + H_2 P_p)} w + \frac{KP_p H_1}{1 + K(H_1 + H_2 P_p)} w \\ &+ \frac{-KP_p}{1 + K(H_1 + H_2 P_p)} H_2 n \end{aligned}$$

In the nominal case ($P_p = P$), from Lemma 3.1, it is easy to show that $F_1 = G - \tilde{G}z^{-d}$, and $F_2 G z^{-d} = \tilde{G}z^{-d}$, so $F_1 + F_2 G z^{-d} = G$.

Thus:

$$\begin{aligned} H_1 + H_2 P &= F_1 - F_k F_1 z^{-d} + (F_2 + F_k - F_k F_2 z^{-d}) P \\ &= F_1(1 - F_k z^{-d}) + F_2 P(1 - F_k z^{-d}) + F_k P \\ &= G \end{aligned} \quad (24)$$

Then, replacing (22)–(24) in the above expressions, (19)–(21) is obtained. \square

■

Remark 2. Note that, contrarily to most approaches presented in the literature (except the one proposed in [24]), the characteristic equation of all sensitivity functions is delay-free.

4.1. Internal stability

Lemma 4.2. The controlled system depicted in Fig. 2, where $K(z)$ has been designed to stabilize $G(z)$, is internally stable.

Proof. The proof is straightforward. Note that, in (19)–(21), $K(z)$ has been designed to stabilize $1 + K(z)G(z)$, and $H_1(z)$ and $H_2(z)$ are stable filters. \square

Remark 3. Note that the design λ -parameter has no influence in the computation of the predicted undelayed output, and it does not appear in the set-point tracking performance. But this parameter can be tuned in order to reach a tradeoff between load disturbance rejection and robust stability in an easy way, as seen in the next section.

4.2. Tradeoff between performance and robust stability

In order to evaluate the performance of the proposed undelayed output prediction $F_k(z) = 1$ is considered in this section.

Performance: A commonly used measurement of disturbance performance is the integral of the absolute error (IAE) index. The lower the IAE index the better the performance is. If the controlled plant is designed to have an over damped closed-loop system, under constant disturbances the IAE is equal to the integral of the error (IE), and an analytical expression can be obtained by (see, for instance, [6])

$$IAE = \lim_{z \rightarrow 1} \frac{T}{z-1} G_{yw}(z) \quad (25)$$

where T is the sampling period and $G_{yw}(z)$ is as described in (20). Then, the overall IAE is the sum of two terms (20):

$$\begin{aligned} IAE &= IAE_i + IAE_{GP} \\ &= IAE_i + \lim_{z \rightarrow 1} \frac{T}{z-1} (F_1 - F_1 z^{-d}) \\ &= IAE_i + N(1) \frac{\Phi(1, \lambda)}{(1-\lambda)^m} dT \end{aligned} \quad (26)$$

where IAE_i is the contribution of the “ideal” controlled plant (without delay), and the second term is due to the proposed predictor.

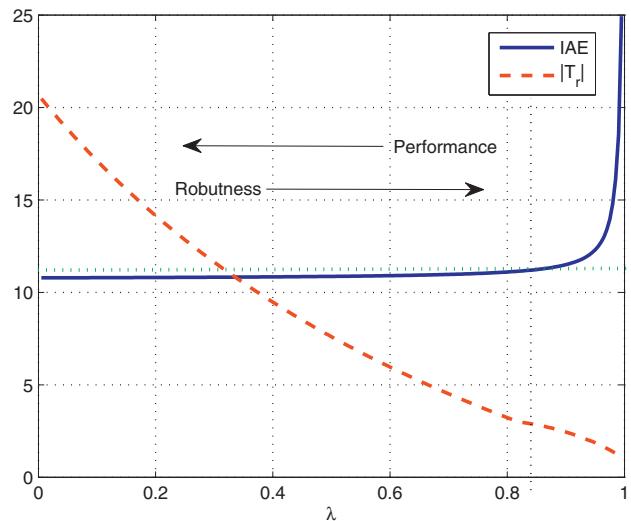


Fig. 4. Plot of IAE and $|T_r|$ according to (26) and (28) respectively (Example 1).

The IAE performance can be computed as a function of the parameter λ .⁴ Then, (26) can be used to compute the value of λ to get a desired IAE by using the proposed control scheme. This performance (26) is plotted as a function of λ in Fig. 4, for the process model of Example 1 in Section 6.

Robustness: For multiplicative uncertainties, that is, if a process transfer function $P_p(z) = P(z)(1 + W(z))$ is assumed, where $W(z)$ defines the process multiplicative uncertainty bound, the robust stability condition is obtained from the output-noise sensitivity function

$$\left\| T_r \frac{KG}{1 + KG} W \right\|_\infty < 1 \quad (27)$$

where

$$T_r = (F_2 z^{-d} - F_2 - 1) = \frac{\tilde{N}^*(z)z^{-d} - \tilde{N}^*(z) - (z - \lambda)^m}{(z - \lambda)^m} \quad (28)$$

The tuning of λ could be done in order to reduce $|T_r|$ in the frequencies of the peak of $(|KG/(1+KG)W|)$, increasing the controlled plant robustness. But it is well known that for any closed-loop control system the higher the robustness is the lower the performance is obtained, then a tradeoff between both properties should be considered.

The robustness function (28) for the same process model of Example 1 in Section 6 is plotted as a function of λ in Fig. 4.⁵ The lower the robustness function the more robust the controlled plant is. This easy and intuitive graphical plot can be used to find some value of λ to achieve a tradeoff between IAE and robust stability.

It can be seen that the lower the λ parameter is the lower IAE is obtained but there is a considerable increment in the robustness function (28) (i. e., the robustness decreases). Nevertheless, this effect is bounded. Note that if $|\lambda| \geq 1$ the system becomes unstable because an unstable pole is introduced in the predictor scheme. The internal stability is not preserved anymore.

Predictor error filter $F_k(z)$:

In order to improve the robustness, the predictor error filter $F_k(z)$ can be also included. This filter can be any stable and steady-state

⁴ Note that $\Phi(1, \lambda)$ depends on both, λ and the process model parameters. In all the examples considered in this work the higher this parameter is the higher the IAE is, but an analytical study of the effect of this parameter for any kind of systems is out of the scope of this work and will be a matter of further research.

⁵ Similar result are obtained for all considered examples in this work.

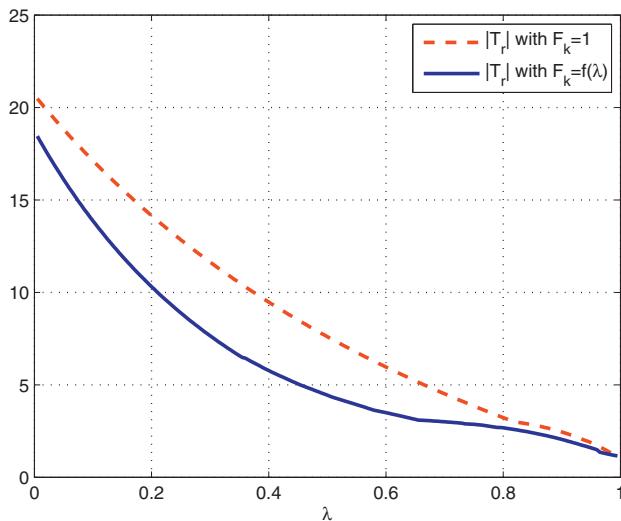


Fig. 5. Plot of T_r in (28) and (23) respectively.

unitary gain filter, but in order to simplify the number of tuning parameters, in this work, the following filter is considered

$$F_k(z) = \frac{(1-\lambda)^m}{(z-\lambda)^m} \quad (29)$$

In that case, the IAE introduced by the DTC structure can be computed by:

$$IAE_{GP} = \frac{\Phi(1, \lambda)N(1)}{(1-\lambda)^m} dt + \frac{\Phi(1, \lambda)N(1)mT}{(1-\lambda)} \quad (30)$$

and the robustness function (28) will be $T_r = H_2$, (23).

For the same Example 1 in Section 6, the robustness function (23) is plotted as a function of λ in Fig. 5, for $F_k = 1$ (same as in Fig. 4) and for $F_k(\lambda)$ (29). Note that for the same λ the robustness function is lower (the robustness is higher) if the prediction error filter is used. Thus, for a given IAE an increment in the robust stability is obtained, although this effect almost vanishes for $\lambda \rightarrow 1$.

The tradeoff between performance and robust stability can be tuned in two stages. First, in designing the main controller $K(z)$. Then, by selecting the λ filter parameter. The first step is independent of the process time-delay and it can be obtained by any robust design method, leading to an inner control loop weighting these characteristics. Once this step is fulfilled, the global balance between performance and robustness can be fine tuned by the λ parameter.

5. Tuning design procedure

In this section a general, easy, intuitive and systematic procedure to design the control structure of Fig. 2 is outlined. The proposed procedure is as follows:

- (1) **Design of the main controller $K(z)$:** First, a discrete model of the process is obtained by using an appropriate sampling period T , according to the controlled plant requirements. Then, this controller is designed according to the closed-loop requirements for the ideal loop⁶ (depicted in Fig. 1). It can be any

controller, depending on the requirements. As a result, an output/reference transfer function $M(z)$ will be obtained:

$$M_c(z) = M(z)z^{-d}; \quad M(z) = \frac{G(z)K(z)}{1 + G(z)KG(z)} \quad (31)$$

Note that this set-point tracking design is independent of both, the plant delay, d , and the filter parameter, λ .

If necessary, the reference changes could be filtered or smoothed by means of the filter K_f

$$K_f(z) = \bar{M}^{-1}(z) \frac{(1-\alpha)^n}{(z-\alpha)^n}$$

where \bar{M} is usually taken as the minimum-phase components of M , and α is the only tuning parameter in this filter.

- (2) **Undelayed output prediction:** The undelayed output prediction \bar{y} (8) (Fig. 2) is computed by (13) and (14). It is independent of λ , although this parameter appears in both filters. Its relevance is shown up when the disturbance response or the noise effect are considered.

Note that λ , if it is convenient, can be used in the last step to reach a tradeoff between performance and robust stability. Otherwise it can be set equal to zero.

- (3) **Tradeoff between performance and robust stability:** The tuning of λ could be done in an analytical way according to (26) and (27), or as a rule of thumb: the larger the parameter λ the more robust the system is but a decrease in the load disturbance rejection results. In order to improve the robustness, the predictor error filter $F_k(z)$ can be also included. As both indices (30) and (23) depend on the λ -parameter and the plant model but not on the designed controller, for a given plant model it is possible to provide a graphical tuning procedure to find a value of λ to have a given tradeoff between the IAE performance and the robust stability.

6. Illustrative examples

In this section the proposed GP-based control schema is applied to several processes recently used in the literature to illustrate the design procedure as well as the variety of situations that can be considered. Similar to the SP [30], the controller parameters on the proposed scheme can be tuned by following any general purpose control design tuning rules for delay-free plants, [6], or by means of a specific method for DTC in the delay free sensitivity functions [33]. Nevertheless, the predictor should take into account the actual plant delay and thus, affecting the global performances.

The results are compared with two schemes conceived to improve the performance of integrating [3] and unstable time-delay systems [19]. For a fair comparison, the proposed controller is tuned to provide similar disturbance performance, then robustness is evaluated for each scheme. Performance and robustness are compared using standard metrics.

To evaluate the control performance, the integrated absolute error (IAE) and the total variation (TV) of the manipulated input $u(t)$, $TV = \sum_{i=1}^{i=\infty} |u_{i+1} - u_i|$, are computed. Both indices should be as small as possible [28]. To evaluate the robustness standard robustness metrics such as Gain margin (M_g) and Phase margin (ϕ_m) are used. Some times, these figures cannot capture the idea of stability margin [6]. An alternative measure of the stability margin is the delay margin (DM), that is, the maximum extra time delay admitted before the controlled plant becomes unstable, [2], which is also considered as a robustness measurement.

Keeping in mind the waterbed effect, for integrating and unstable time-delay systems the most critical point is the trade-off between disturbance rejection and robustness. The set-point

⁶ The tuning of this controller can be done either in the discrete or continuous time framework, to be implemented in discrete time, and it is design for the delay-free plant model.

Table 1

Performance and robustness (nominal case of Example 1)

| Load disturbance | IAE | TV | M_g | ϕ_m | DM |
|------------------|-------|------|-------|----------|------|
| [3] | 11.78 | 0.20 | 1.65 | 50.50 | 4.35 |
| GP | 11.72 | 0.15 | 1.94 | 44.16 | 4.38 |

IAE and TV are computed for load disturbance case ($t > 80$ s in Fig. 7).

tracking can be always modified by an ad-hoc set-point filter. Note that, for unstable systems, robustness cannot be increased arbitrarily. This is an expected result because certain feedback action is needed to maintain stability, thus, the detuning of the controller has a limit [26].

To illustrate different properties, the following systems will be considered:

- (1) An integrating process with dead-time [3], to show a detailed application of the design procedure.
- (2) A double integrator process with a dead-time, also treated in [3].
- (3) An unstable system taken from [19].
- (4) The two previous cases, 1 and 3, initially assumed with the same delays as reported in the referred papers, but now with a very long delay.

Example 1. Let us consider an integrating process with dead-time [3]:

$$P_p(s) = \frac{e^{-4s}}{s(s+1)}$$

Following the design procedure, let us consider the scheme in Fig. 1. The tuning of the controller can be done to fulfill some requirements, for example, a 0% overshoot and recovery time of 60s for step load disturbance. Then, the PID controller for the delay-free plant could be such as:

$$K(s) = 0.21 \frac{(s+1)(s+1/20)}{s(0.1s+1)}$$

A suitable sampling time, such as $T=0.2$ s, is considered, although it could be larger. The discrete time controller $K(z)$ is obtained by discretizing $K(s)$, and the discrete process model is:

$$G(z) = \frac{0.018731(z+0.9355)}{(z-1)(z-0.8187)}$$

Following the design procedure (second step), with $\lambda=0$:

$$\Gamma(z) = \frac{0.018731(z+0.9355)}{z} \quad (32)$$

$$\tilde{G}(z) = \frac{z}{(z-1)(z-0.8187)} \quad (33)$$

Thence, the filters $F_1(z)$ and $F_2(z)$ are computed from (32) and (33) by (13) and (14) respectively with $d=L/T=20$. The obtained results, assuming $F_k(z)=1$, compared with the ideal closed-loop delay-free system (see Fig. 1), are shown in Fig. 6.

In order to improve the robust tuning of the overall closed-loop system the parameter λ should be adjusted (third step). In this example, and in order to compare with the proposal in [3], the parameter λ is computed from (30) to obtain in both a similar IAE (see Table 1), being taken as $\lambda=0.84$.

$$\Gamma(z) = \frac{0.0048374(z+0.9672)}{(z-0.84)} \quad (34)$$

$$\tilde{G} = \frac{(z-0.84)}{(z-1)(z-0.9048)} \quad (35)$$

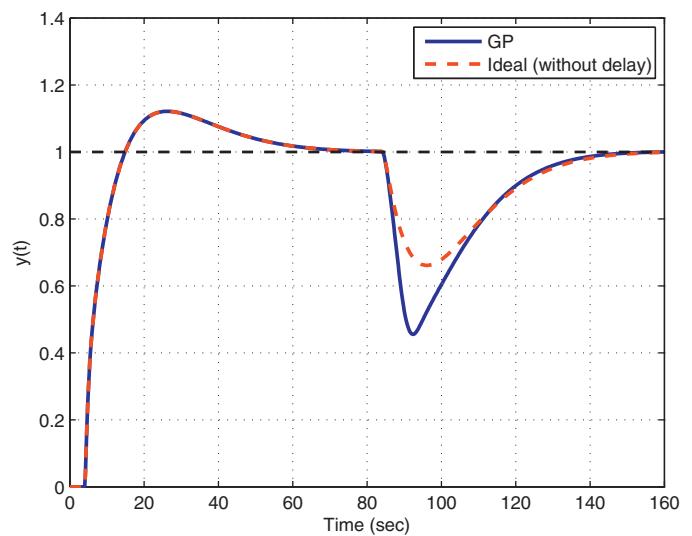


Fig. 6. Nominal output response compared with the ideal closed-loop system free of delay for a unit step change in the reference and a step load disturbance of -0.1 at $t=80$ s. (Example 1).

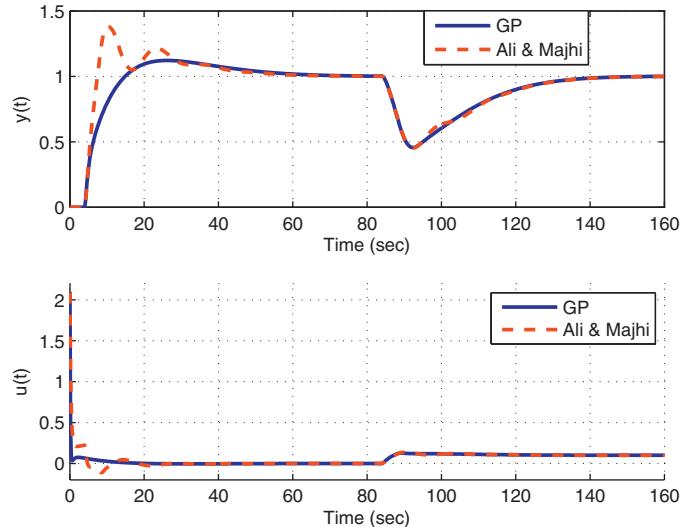


Fig. 7. Nominal system responses for a unit step change in the reference and a -0.1 step load disturbance at $t=80$ s (Example 1).

Thence, the filters $F_1(z)$ and $F_2(z)$ are computed from (34) and (35) with $d=20$, the predictor error filter being:

$$F_k(z) = \frac{(1-0.84)}{(z-0.84)}$$

In [3], the following parallel PID-controller is designed based on the delayed plant model:

$$PID(s) = k_c(1 + \frac{T_d s}{T_f s + 1} + \frac{1}{T_i s})$$

where $k_c=0.19$, $T_i=22.37$, $T_d=2.79$ and $T_f=0.279$, are the result of an optimization process where the delayed plant model is used.

For the nominal case, the results obtained, compared with those in [3] are shown in Figs. 7 and 8 and Table 1, where the different metrics for performance and robustness are collected.

Similar to [3], the robust performances of the proposed scheme is studied by assuming a 20% change in the steady state gain or the plant delay. The results obtained, compared with those in [3], are shown in Fig. 9 and Fig. 10 and Table 2. In both cases, the IAE

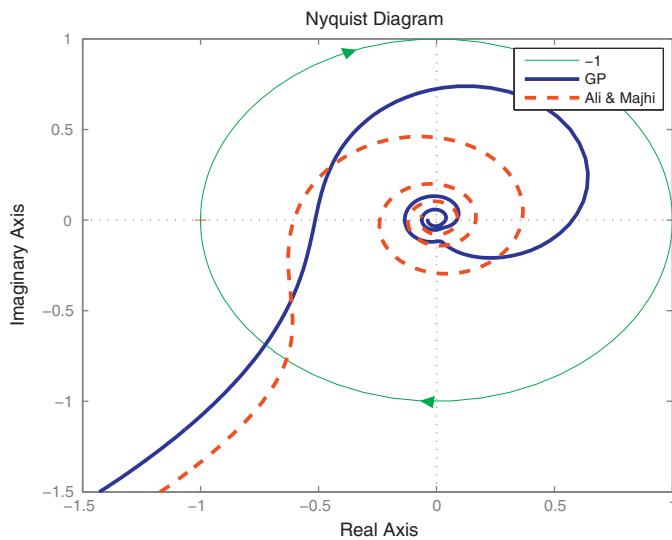


Fig. 8. Nyquist plots for Example 1.

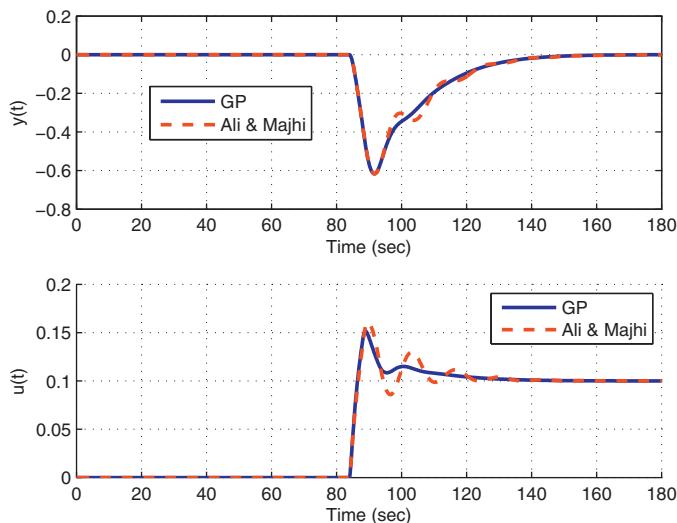


Fig. 9. Responses for a change of 20% in process gain (Example 1).

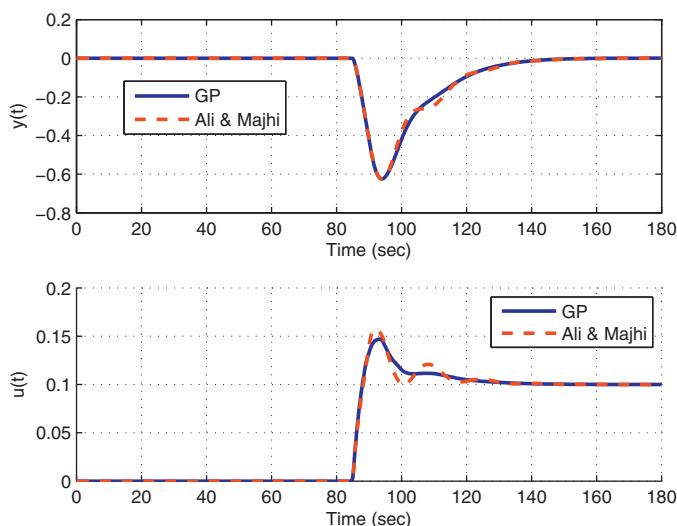


Fig. 10. Responses for a change of 20% in process time delay (Example 1).

Table 2
Performance and robustness (perturbed cases Example 1)

| | +20% gain | | +20% time delay | |
|-----|-----------|------|-----------------|------|
| [3] | IAE | TV | IAE | TV |
| GP | 11.76 | 0.34 | 11.77 | 0.26 |
| GP | 11.69 | 0.21 | 11.70 | 0.19 |

IAE and TV are computed as before, for load disturbance, with a 20% change in the steady state gain and the plant delay.

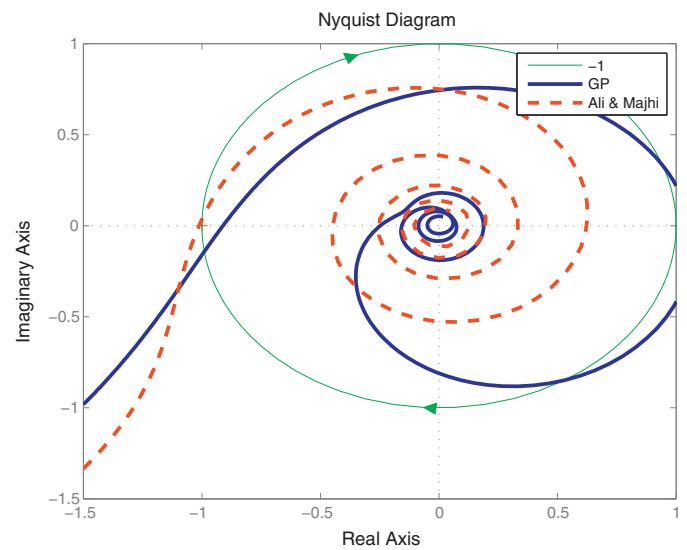


Fig. 11. Nyquist plots, for the perturbed case when time delay and gain are increased by 40% (Example 1).

is similar for both schemes but the TV is better in the proposed scheme.

If the modeling errors are increased in both, the delay and gain, the difference could be greater. For a 40% modeling errors, the proposal of [3] becomes unstable whereas the GP remains stable (see Nyquist plot in Fig. 11), but it is fair to note that the differences are not so large and both designs are acceptable for reduced model mismatching and low time delays.

Finally, let us consider the effect of a white noise in the measurement device, with a power spectrum of 0.02. For the nominal case, the results are shown in Fig. 12.

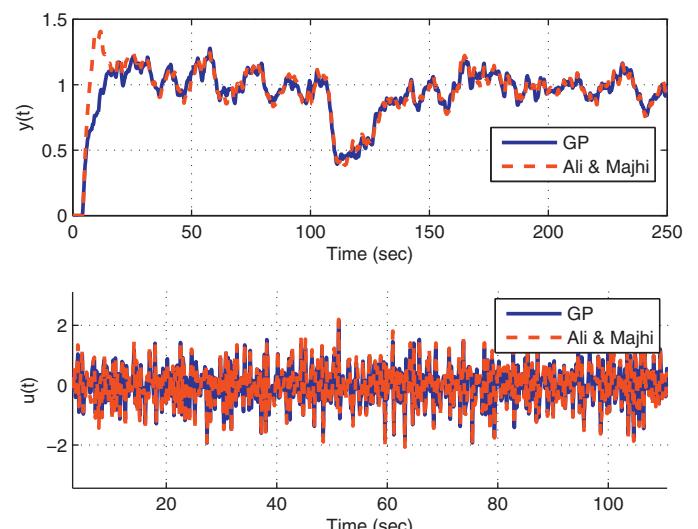


Fig. 12. Nominal system responses for white-noise measurement (Example 1).

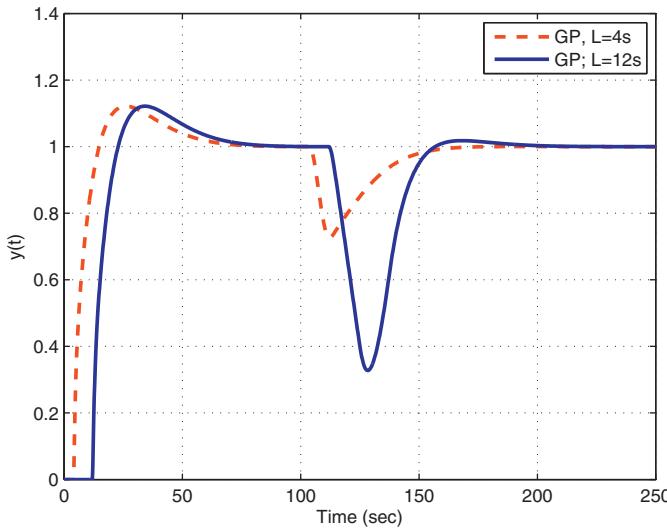


Fig. 13. Nominal system responses for a -0.05 step disturbance at $t = 100$ s (Example 2).

For this example it is worth to conclude that, if both schemes are tuned to have the same IAE in the nominal case, the phase margin is slightly higher in the scheme proposed by Ali and Maihi [3], but the gain margin and the Nyquist plot distance to the $(-1, 0)$ point (M_s) are lower, the DM being similar. For gain or delay uncertainties the computed IAE is similar for both schemes but the TV is better in the GP. For simultaneous uncertainties (in both delay and gain), the proposed scheme shows better robustness again uncertainties and load disturbance rejection.

Example 2. Now let us consider the same integrating process but with a much higher dead-time:

$$P_p(s) = \frac{e^{-12s}}{s(s+1)}$$

The authors in [3] announce major difficulties in the controller design for dead-time greater than 10, and “for delay dominated plants, the Smith predictor should be used for integrating plant models with large time delay”.⁷

Following the proposed methodology, the controller $K(z)$ and the predictor error filter $F_k(z)$ are initially the same that those computed in the previous case. The filters $F_1(z)$ and $F_2(z)$ are computed from (34) and (35), with the same sampling period $T=0.2$ s, but with $d=L/T=60$. Then, the comparative results as a function of the delay are shown in Fig. 13. The worsening of the robustness against model uncertainties is shown in Fig. 14.

Note that as expected by the nature of the integrative systems, the robustness and the load disturbance rejection are degraded as far as the time delay increases. If necessary, a robustness improvement can be done by the λ -parameter, but at the expense of decreasing the load disturbance rejection. Also, the initially designed robust control $K(z)$ can be redesigned.

Example 3. Let us now consider a double integrator process with a dead-time, also treated in [3]:

$$P_p(s) = \frac{e^{-s}}{s^2}$$

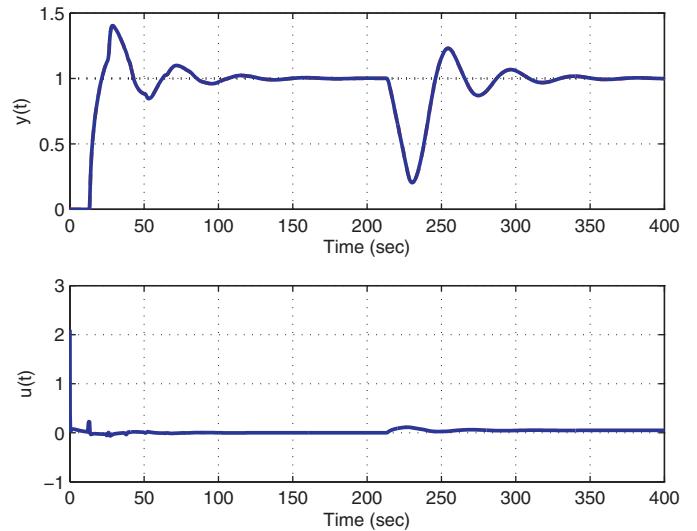


Fig. 14. Perturbed system responses when the delay and gain are increased by 10% for a -0.05 step disturbance at $t = 100$ s (Example 2).

Table 3

Nominal performance and robustness (Example 3)

| Load disturbances | IAE | TV | M_g | ϕ_m | DM |
|-------------------|-------|------|-------|----------|------|
| [3] | 25.17 | 0.46 | 1.82 | 15.21 | 0.47 |
| GP | 24.73 | 0.29 | 1.95 | 19.47 | 0.70 |

Following the design procedure, the tuning of the controller can be done to fulfill some requirements for a step load disturbance, for example:

$$K(s) = 0.20 \frac{(2.5s + 1)(s + 1/5)}{s(0.25s + 1)}$$

The following set-point filter could be included if the overshoot should be avoided:

$$K_f(s) = \frac{M(s)^{-1}}{(3s + 1)^2}$$

The discrete time controllers $K(z)$ and $K_f(z)$ are obtained by discretizing the previous $K(s)$ and $K_f(s)$, where $T=0.2$ s. The discrete process model is:

$$G(z) = \frac{0.02(z + 1)}{(z - 1)^2}$$

Note that a zero appears at $z = -1$. Then, following the design procedure, the λ parameter should be adjusted. In this example, and in order to compare with the proposal in [3], $\lambda = 0.953$ is selected to obtain the same IAE for the nominal case there proposed (see Table 3).

$$\Gamma(z) = \frac{0.02(z + 1)}{(z - 0.953)} \quad (36)$$

$$\tilde{G} = \frac{(z - 0.953)}{(z - 1)^2} \quad (37)$$

Thence, the filters $F_1(z)$ and $F_2(z)$ are computed from (36) and (37) by (13) and (14) respectively.

As before, in [3], the following PID is proposed:

$$PID(s) = kc \left(1 + \frac{T_d s}{T_f s + 1} + \frac{1}{T_i s} \right)$$

⁷ Quoted from [3].

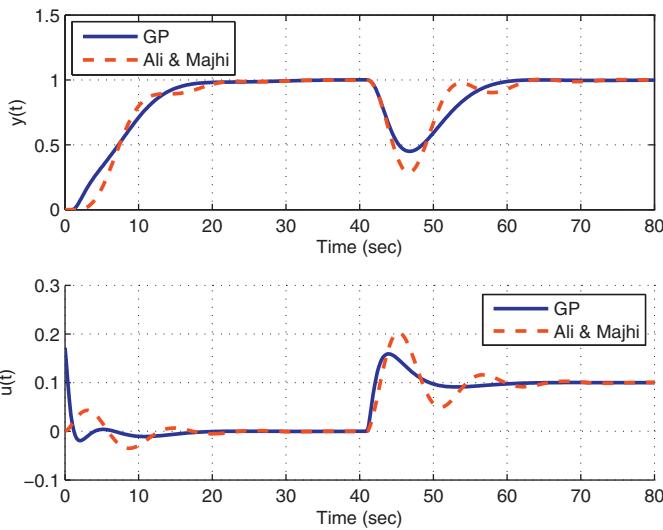


Fig. 15. Nominal system responses for a -0.1 step disturbance at $t = 100$ s (Example 3).

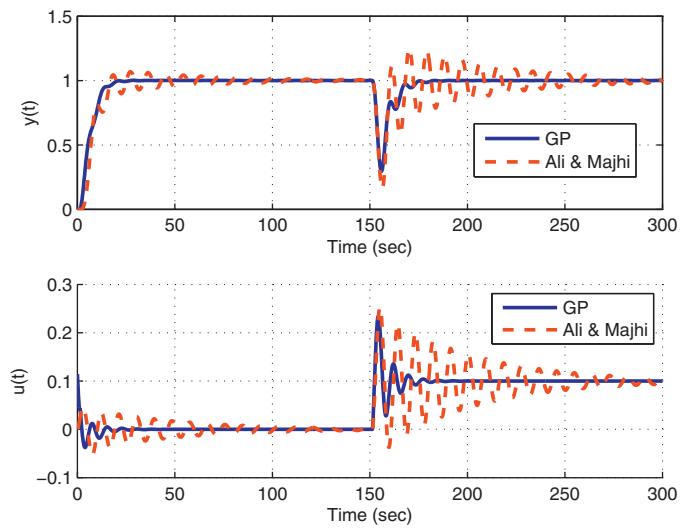


Fig. 17. Closed loop responses for the perturbed case when the delay and gain are increased by 25% (Example 3).

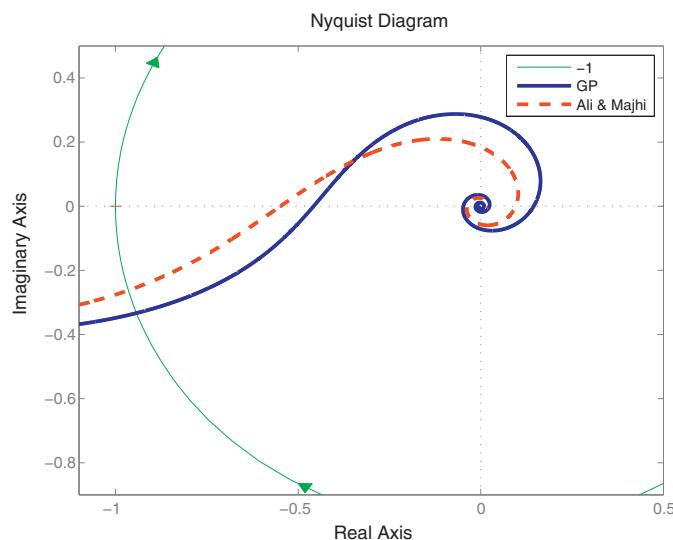


Fig. 16. Nyquist plots for Example 3.

where a set-point filter is also included in order to avoid the overshoot:

$$F_{sp}(s) = \frac{1}{T_i T_d s^2 + T_i s + 1}$$

with $k_c = 0.17$, $T_i = 8.51$, $T_d = 2.87$ and $T_f = 0.287$.

The results obtained, compared with those in [3] are shown in Fig. 15 and Table 3 (see also the Nyquist plots in Fig. 16).

If the modeling errors are increased by 25% in both, the delay and gain, the results are shown in Fig. 17.

Again, if the modeling errors are increased by 50% the proposal of [3] becomes unstable whereas the GP remains stable.

Thus, for a double integrator process, it is possible to conclude that, if both schemes are tuned to have a similar IAE for regulatory proposes in the nominal case, the proposed scheme shows a slightly improvement in the performance and robustness again uncertainties. Note that also the DM is higher in the GP.

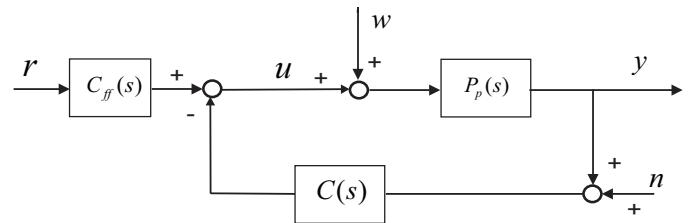


Fig. 18. MSP-PID control structure proposed in [19].

Example 4. Let us consider an unstable processes with a dead-time [19]:

$$P_p(s) = \frac{2}{(10s-1)(2s+1)} e^{-5s}$$

In the scheme proposed in [19], the so called MSP-PID, the following controllers are proposed (see Fig. 18):

$$C(s) = \gamma \frac{k_d s^2 + k_s + k_i}{s(T_f s + 1)} F_c(s)$$

for the output feedback, and

$$C_{ff}(s) = \gamma \frac{bks + k_i}{s} F_c(s)$$

for the set-point tracking, and

$$F_c(s) = \frac{(a_2 s^2 + a_1 s + 1)}{(a_2 s^2 + a_1 s + 1 + \eta)}$$

where $\gamma = 1$, $k = 4.1452$, $k_d = 6.7044$, $k_i = 0.1960$, $T_f = 0.2871$, $b = 0$, $\eta = 2.864$ and $a_1 = \tau/2$, and $a_2 = \tau^2/12$ with $\tau = 7$ are the result of an optimization process where the delayed plant model is used. Following the tuning procedure here proposed, the main controller and set-point filter are tuned to fulfill the closed-loop stability. Assume, for example, the PID controller⁸:

$$K(s) = 2.9 \frac{(2s+1)(s+1/10)}{s(0.1s+1)}$$

⁸ This controller should be designed according to the disturbance rejection requirements, in the general case.

Table 4
Performance and robustness (Example 4)

| Load disturbances | IAE | TV | M_g | ϕ_m | DM |
|-------------------|-------|------|-------|----------|------|
| [19] | 28.57 | 0.53 | 1.36 | 15.22 | 1.33 |
| GP | 26.54 | 0.42 | 1.40 | 17.11 | 1.51 |

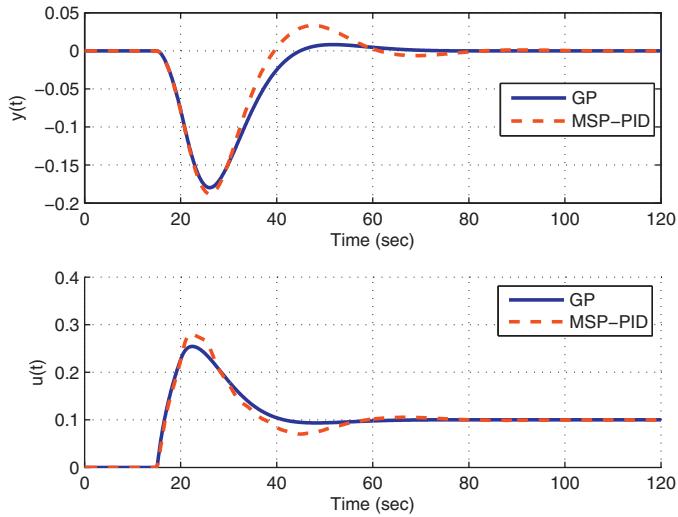


Fig. 19. Nominal system responses for a -0.1 step disturbance at $t = 10$ s (Example 4).

The set-point filter, can be taken as:

$$K_f(s) = M^{-1}(s) \frac{1}{(\alpha s + 1)^2}$$

with $\alpha = 5$; The proposed scheme (Fig. 2) is implemented with a sampling time of $T = 0.1$ s. The parameter λ is adjusted to obtain a IAE slightly lower than the one in the MSP-PID, that is with $\lambda = 0.98$ the IAE is 26.54 (see Table 4), then:

$$\Gamma(z) = \frac{0.00049342(z + 0.9868)}{(z - 0.98)} \quad (38)$$

$$\tilde{G} = \frac{(z - 0.98)}{z - 1.01(z - 0.9512)} \quad (39)$$

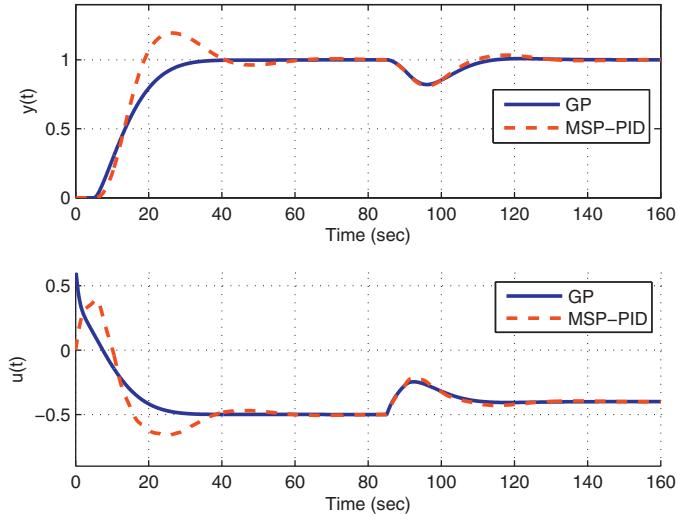


Fig. 20. Nominal system responses for an unit step in the set-point and a -0.1 step disturbance at $t = 80$ s (Example 4).

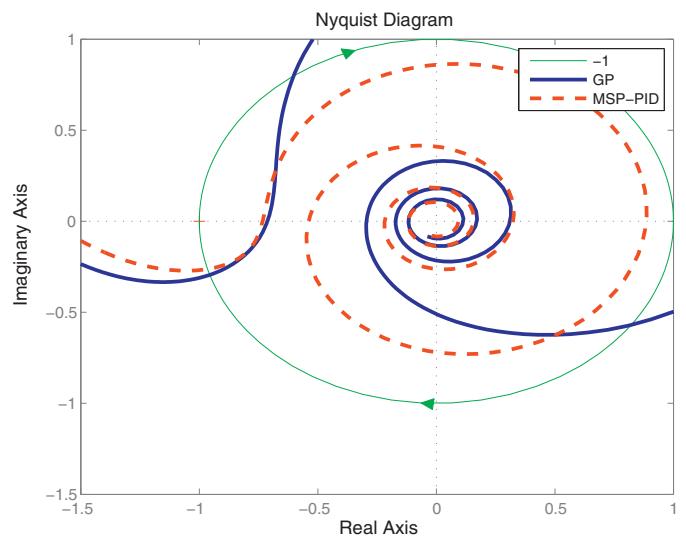


Fig. 21. Nyquist plots for Example 4.

Thence, the filters $F_1(z)$ and $F_2(z)$ are computed from (38) and (39) with $d = 50$, being $F_k(z) = ((1 - 0.98)/z - 0.098)$.

The obtained results, compared with those in [19], are shown in Fig. 19 and Table 4 (see also Nyquist plots in Fig. 21). In Fig. 20 the same simulation but including a unit step change in the set-point is considered (Fig. 21).

In order to evaluate the robust performances of the proposed scheme, a variation of -18% in all process parameters is assumed, as done in [19]. The obtained results, are shown in Fig. 22.

But, if the parameter variations in the process are $+25\%$ in the time delay and -25% in the other parameters, that is, for

$$P_p(s) = \frac{0.13333e^{-6.3s}}{(s + 0.66667)(s - 0.1333)}$$

the results obtained, compared with those in [19], are shown in Fig. 23. Note that the control proposed in [19] becomes unstable whereas the GP is stable.

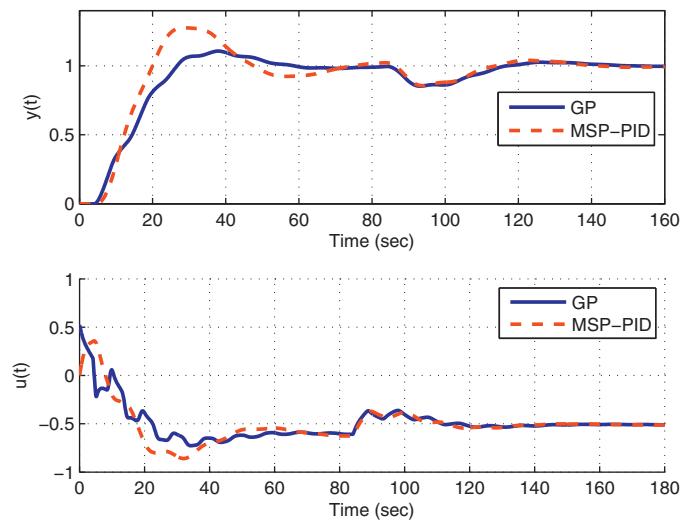


Fig. 22. Perturbed system responses; all process parameters are changed by -18% (Example 4).

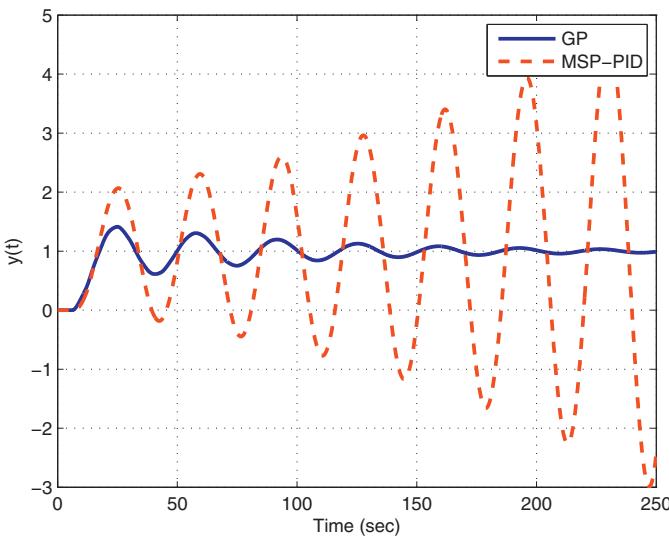


Fig. 23. Closed loop responses for the perturbed case when the time delay is increased by 25% and other parameters are decreased by -25% (Example 4).

Example 5. Let us consider the same unstable processes but with a longer dead-time:

$$P_p(s) = \frac{2}{(10s - 1)(2s + 1)} e^{-12s}$$

The proposed scheme has been implemented with the filters $F_1(z)$ and $F_2(z)$ computed from (38) and (39), but with $d = L/T = 120$. Being the controller $K(z)$ and the predictor error filter $F_k(z)$ the same that in the previous example. Then, the results in Figs. 24 and 25 are obtained.

As pointed out in Example 2, the proposed controller design methodology is independent on the delay but, as expected by the nature of the unstable plant, the robustness index and the load disturbance rejection are degraded as far as the time delay increases. If necessary, a robustness improvement can be done by the λ -parameter, but at the expense of decreasing the load disturbance rejection.

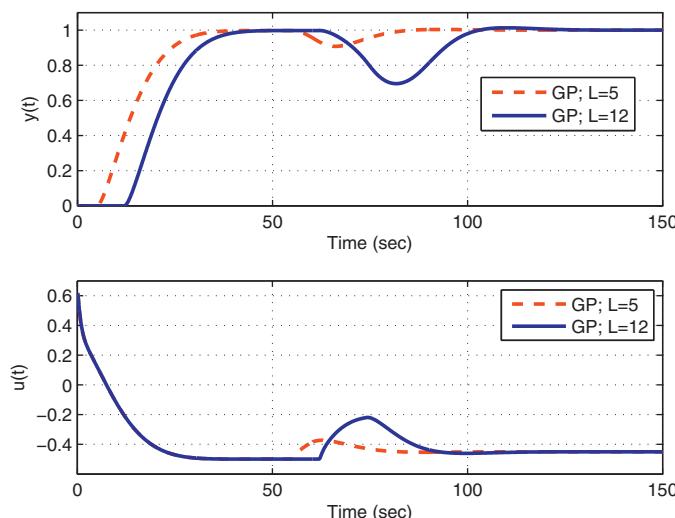


Fig. 24. Nominal system responses for a -0.05 step load disturbance at $t=100$ s (Example 5).

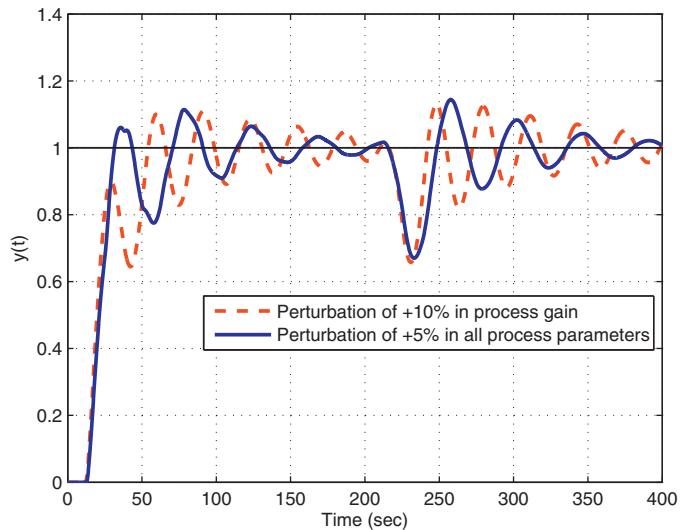


Fig. 25. Perturbed system responses for a -0.05 step load disturbance at $t=200$ s (Example 5).

7. Conclusions

The GP has been shown to be a convenient alternative to the classical SP, allowing the delay-free control design for stable, integrating or unstable processes with large time delay. Based on this new predictor, where a new tuning parameter has been included, a control structure has been proposed. It can be seen that the λ -parameter can improve the robustness, the larger the λ -parameter the lower the disturbance performance is obtained but an increment in the robustness results. This new parameter can also be introduced in the prediction error filter to get an intuitive tradeoff between performance and robust stability. The main advantages of the proposed structure is the easy tuning and industrial implementation as well as the intuitive effect of the control parameters. Similarly to the original SP, any suitable control structure and design for the free-delay process can be applied, independently on the proposed GP.

The proposed control scheme has been applied and the results compared to those recently published by using alternative approaches, where excellent results were claimed. In the reported examples, disturbance rejection and robustness against model uncertainties and measurement noise have been considered. Our proposal, as described in the previous sections, is general, applicable to any kind of plants with long time delays and it can be easily designed and implemented, leading to better results.

It is worth to remark that the main controllers are designed independently of the delay. The same controllers are applied for the same system if the time delay is changed, and the reference responses are the same in all cases, as can be seen in Figs. 6, 13 or 24, where the delay effect on disturbance rejection is also shown. The delay is taken into account in designing the predictor and its negative effects can be balanced by means of the tuning parameter λ .

Acknowledgements

This work has been partially granted by the Spanish Ministry of Education research Grants DPI2011-28507-C02-01 and PAIDI-06-12. The authors are also grateful to the Associate Editor and anonymous reviewers for their valuable feedback and comments.

References

- [1] P. Albertos, P. García, Robust control design for long time-delay systems, *Journal of Process Control* 19 (10) (2009) 1640–1648.
- [2] Pedro Albertos, Phase-conditionally stable systems, *Systems and Control Letters* 55 (10) (2006) 803–808.
- [3] Ahmad Ali, Somanath Majhi, PID controller tuning for integrating processes, *ISA Transactions* 49 (1) (2010) 70–78.
- [4] K.J. Åström, Model uncertainty and feedback, in: P. Albertos, A. Sala Piqueras (Eds.), *Iterative Identification and Control*, Springer Verlag, New York, 2002.
- [5] K.J. Åström, C.C. Hang, B.C. Lim, A new smith predictor for controlling a process with an integrator and long dead time, *IEEE Transactions on Automatic Control* 39 (1994) 343–345.
- [6] K.J. Åström, T. Hägglund, Advanced PID Control, ISA – The Instrumentation, Systems, and Automation Society, Research Triangle Park, NC 27709, 2005.
- [7] K.J. Åström, B. Wittenmark, *Computer Controlled Systems: Theory and Design*, 3rd ed., Prentice-Hall, Englewood Cliffs, NJ, 1997.
- [8] P. García, P. Albertos, T. Hägglund, Control of unstable non-minimum-phase delayed systems, *Journal of Process Control* 16 (2006) 1099–1111.
- [9] P. García, P. Albertos, A new dead-time compensator to control stable and integrating processes with long dead-time, *Automatica* 44 (4) (2008) 1062–1071.
- [10] P. García, T. Santos, J.E. Normey-Rico, P. Albertos, Smith predictor-based control schemes for dead-time unstable cascade processes, *Industrial and Engineering Chemistry Research* 49 (2010) 11471–11481.
- [11] J.L. Guzmán, P. García, T. Hägglund, S. Dormido, P. Albertos, M. Berenguel, Interactive tool for analysis of time-delay systems with dead-time compensators, *Control Engineering Practice* 16 (7) (2008) 824–835.
- [12] T. Hägglund, An industrial dead-time compensating PI controller, *Control Engineering Practice* 4 (1996) 749–756.
- [13] T. Hägglund, A predictive PI controller for process with long dead-times, *IEEE Control Systems Magazine* 12 (1) (1992) 57–60.
- [14] A. Ingimundarson, T. Hägglund, Robust tuning procedures of dead-time compensating controllers, *Control Engineering Practice* 9 (11) (2001) 1195–1208.
- [15] T. Liu, W. Zhang, D. Gu, Analytical design of two-degree-of-freedom control scheme for open-loop unstable processes with delay, *Journal of Process Control* 15 (2005) 559–572.
- [16] X. Lu, Y.-S. Yang, Q.-G. Wang, W.-X. Zheng, A double two-degree-of-freedom control scheme for improved control of unstable delay processes, *Journal of Process Control* 15 (2005) 605–614.
- [17] S. Majhi, D.P. Atherton, Obtaining controller parameters for a new smith predictor using autotuning, *Automatica* 36 (2000) 1651–1658.
- [18] M.R. Mataušek, A.D. Micić, On the modified smith predictor for controlling a process with an integrator and long dead-time, *IEEE Transactions on Automatic Control* 44 (1999) 1603–1606.
- [19] M.R. Mataušek, A.I. Ribić, Control of stable, integrating and unstable processes by the modified smith predictor, *Journal of Process Control* 22 (2012) 338–343.
- [20] W. Michiels, S.I. Niculescu, On the delay sensitivity of smith predictors, *International Journal of Systems Science* 34 (2003) 543–552.
- [21] J.E. Normey-Rico, C. Bordons, E.F. Camacho, Improving the robustness of dead-time compensating pi controllers, *Control Engineering Practice* 5 (1997) 801–810.
- [22] J.E. Normey-Rico, F. Eduardo, Camacho, Dead-time compensators: A survey, *Control Engineering Practice* 16 (4) (2008) 407–428.
- [23] J.E. Normey-Rico, E.F. Camacho, *Control of Dead-time Processes*, Springer, Berlin, 2007.
- [24] J.E. Normey-Rico, E.F. Camacho, Unified approach for robust dead-time compensator design, *Journal of Process Control* 19 (2009) 38–47.
- [25] J.E. Normey-Rico, E.F. Camacho, A unified approach to design dead-time compensators for stable and integrative process with dead-time, *IEEE Transactions on Automatic Control* 47 (2002) 299–305.
- [26] J.E. Normey-Rico, E.F. Camacho, Unified approach for robust dead-time compensator design, *Journal of Process Control* 19 (1) (2009) 38–47.
- [27] A. Sesagiri Rao and M. Chidambaram PI/PID controllers design for integrating and unstable systems (chapter 3), pp. 75–111. In R. Vilanova, A. Visioli (Eds.), *PID control in the third millennium, advances in industrial control*, Springer, London, 2012.
- [28] S. Skogestad, Simple analytic rules for model reduction and PID controller tuning, *Journal of Process Control* 13 (4) (2003) 291–309.
- [29] S. Skogestad, I. Postlethwaite, *Multivariable Feedback Control Analysis and Design*, Published by Wiley, 1996 May.
- [30] O.J.M. Smith, Closer control of loops with dead time, *Chemical Engineering Progress* 53 (1959) 217–219.
- [31] W. Tan, H.J. Marquez, T. Chen, Imc desing for unstable processes with time delays, *Journal of Process Control* 13 (2003) 203–213.
- [32] Y.-C. Tian, F. Gao, Double-control scheme for control of processes with dominant delay, *IEEE Proceedings on Control Theory and Applications* 145 (1998) 479–484.
- [33] A. Visioli, Q. Zhong, *Control of integral processes with dead time*, Springer, London, 2010.
- [34] Q.-G. Wang, H.-Q. Zhou, Y. Zhang, Y. Zhang, A comparative study on control of unstable processes with time delay, in: *5th Asian Control Conference*, Melbourne, Australia, 2004 July, pp. 2006–2014.
- [35] Q.-C. Zhong, J. Normey-Rico, Control of integral processes with dead-time. part 1: Disturbance observer-based 2 dof control scheme. *Control Theory and Applications*, *IEEE Proceedings* 149 (4) (2002) 285–290.